

# On/Off actuator BES-CT430920

# **Programming manual**





# Index

1	GEN	ERAL DESCRIPTION	3
2	TECH	INICAL INFORMATION	4
3	PRO	GRAMMING	5
	3.1	APPLICATION PROGRAM INFORMATION	5
	3.2	INDIVIDUAL ADDRESS ASSIGNMENT	5
	3.3	TYPE OF DEVICE	6
	3.4	OUTPUTS OBJECTS	8
	3.4.1	Binary outputs table	8
	3.4.2	Binary outputs description	8
	3.4.3	Blind outputs table	9
	3.4.4	Blind outputs description	9
	3.4.5	Fan-coil outputs table	10
	3.4.6	Fan coil outputs description	12
	3.4.7	Thermo-valve outputs table	13
	3.4.8	Thermo-valve outputs description	14
	3.5	OUTPUTS PARAMETERS	14
	3.5.1	Binary outputs parameters	14
	3.5.2	Blind outputs parameters	17
	3.5.3	Fan-coil outputs parameters	19
	3.5.4	Thermo-valve outputs parameters	20
	3.6	ADVANCED FUNCTIONS	21
	3.6.1	Arithmetic and Logic block (ALU)	22
	3.6.2	Timer / counter block	23
4	INST	ALLATION	.27





.....


# 1 General description

The Bes ref. CT430920 is an on/off actuator composed of 9 potential-free relay outputs (dry contact).

Its 9 outputs allow controlling 9 on / off electrical circuits, 4 blinds (2 outputs for one blind motor: up phase and down phase) or 2 fan-coils. Due to its high cut off capacity, this device is also recommended for capacitive loads, sockets, and electrical appliances control. The inputs can operate in different modes allowing to control binary outputs, blinds, fan-coil or thermovalves separately or simultaneously

It incorporates an advanced Arithmetic and Logic Unit (UAL) that allows performing complex logic operation, timers programming, counters, etc. using internal results of operations or other external variables.

The cut off capacity of the relays is 16A @ 230Vac (potential free relay output). If necessary, insert a contactor to control higher power circuits.

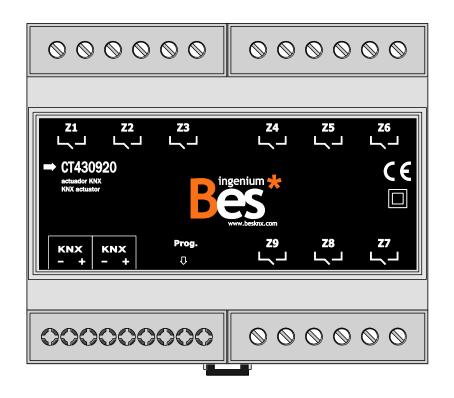

General characteristics:

- 9 potential free relay outputs with a 16A @ 230Vac cut-off capacity.
- Each output can work independently or simultaneously in different modes (binary, blinds, fan-coils...).
- Easy and visual ALU (Arithmetic and Logic Unit) with timers, counters and any logic and arithmetic operation implementation.





.....

# 2 Technical information

Power supply	29V <sub>DC</sub> from KNX BUS
KNX current consumption	9mA from KNX BUS
Mounting	DIN rail
Size	6 DIN modules
Connections	BUS connection terminal KNX Screw terminals for outputs
Outputs	9 potential free relay output.
Outputs cut-off capacity	16A @ 230Vac
Environment temperature range	Operation: -10ºC/55ºC Storage: -30ºC/60ºC Transportation: -30ºC/60ºC
Regulation	According to the directives of electromagnetic compatibility and low voltage: EN 50090-2-2 / UNE-EN 61000-6-3:2007 / UNE-EN 61000-6-1:2007 / UNE-EN 61010-1.





# 3 Programming

#### 3.1 Application program information

.....

- Application program: Ingenium / Actuators v2 (manufacturer / program name).
- Catalogue version: v1.0
- Maximum number of communication objects: 256.
- Maximum number of assignments: 256.
- ETS minimum required version: 4.1.8

The parameters of the device are configured in the ETS into the parameters menu.

1.1.1 Actuators v2 > General			
General	Hardware type	9 outputs	•
+ Outputs configuration	Advanced functions	O No Yes	
+ Channel A 1 - Binary output	Advanced infections		
+ Channel A 2 - Binary output			
+ Channel B 3 - Binary output			
+ Channel B 4 - Binary output			
+ Channel C 5 - Binary output			
+ Channel C 6 - Binary output			
+ Channel D 7 - Binary output			
+ Channel D 8 - Binary output			
+ Channel E 9 - Binary output			
Group Objects / Channels /	Parameter		

#### 3.2 Individual address assignment

This actuator has a programming button for the KNX individual address assignment which is located on the front of the device.

.....

A red LED near the programming button lights up when it is pressed manually or if the device is set remotely to programming

The LED is automatically turned off if the ETS has assigned an individual address correctly or if the programming button is pressed again manually.

mode state.



#### 3.3 Type of device

The parameters of the device are configured in the ETS into the parameter menu.

There are several tabs at the left side to configure different parameters depending on the type of device selected. In this case, the device that must be selected is the type "9 outputs".

.....

Use the selector at the top of the main window to select the type of device to program.

Advanced functions: 2 ampuls - 2 adupts 6 inputs - 4 adupts 6 inputs - 4 adupts 9 adupts 9 adupts 9 adupts 9 adupts 2 adupts 9 adupts 2 adupts 16 adupts 22 outputs 16 adupts 22 outputs 16 adupts 22 outputs 16 adupts 22 outputs 16 adupts 22 outputs 16 adupts 22 outputs 24 adupts 22 outputs 24 adupts 24 adupts 22 outputs 24 adupts 24 a	General	Hardware type	9 outputs	
Advanced functions     forputs - 4 outputs     Gennel A 1 - Binary output     Channel A 2 - Binary output     Channel B 3 - Binary output     Channel C 5 - Binary output     Channel C 6 - Binary output     Channel D 7 - Binary output     Channel D 8 - Binary output	+ Outputs configuration	2000 - 100 - 10		
+       Channel A 2 - Binary output       16 outputs       22 outputs         +       Channel B 3 - Binary output       +       Channel C 5 - Binary output         +       Channel C 5 - Binary output       +       Channel D 7 - Binary output         +       Channel D 8 - Binary output       +       Channel D 8 - Binary output	+ Channel A 1 - Binary output	Advanced functions	6 inputs - 4 outputs	-
<ul> <li>Channel B 4 - Binary output</li> <li>Channel C 5 - Binary output</li> <li>Channel C 6 - Binary output</li> <li>Channel D 7 - Binary output</li> <li>Channel D 8 - Binary output</li> </ul>	+ Channel A 2 - Binary output		16 outputs	
<ul> <li>Channel C 5 - Binary output</li> <li>Channel C 6 - Binary output</li> <li>Channel D 7 - Binary output</li> <li>Channel D 8 - Binary output</li> </ul>	+ Channel B 3 - Binary output			
<ul> <li>Channel C 5 - Binary output</li> <li>Channel D 7 - Binary output</li> <li>Channel D 8 - Binary output</li> <li>Channel D 8 - Binary output</li> </ul>	+ Channel B 4 - Binary output			
+ Channel D 7 - Binary output + Channel D 8 - Binary output	+ Channel C 5 - Binary output			
+ Channel D 8 - Binary output	+ Channel C 6 - Binary output			
	+ Channel D 7 - Binary output			
+ Channel E 9 - Binary output	+ Channel D 8 - Binary output			
	+ Channel E 9 - Binary output			

After that, a number of inputs and outputs appear depending on the model of the device selected. Each of these inputs and outputs can be configured to work in different modes independently and simultaneously. To do so it has to be selected in the left side the tab "Inputs configuration" for the inputs and the tab "Outputs configuration" for the outputs.

Outputs can be disabled or programmed in binary, blinds, fan coil or thermo-valve modes.

1.1.1 Actuators v2 > Outputs con	figuration > Configuration		
General	Channel A - Output 1	Binary output	-
<ul> <li>Outputs configuration</li> <li>Configuration</li> </ul>	Channel A - Output 2 Channel B - Output 3	Disabled Binary output Shutter/blind	y
+ Channel A 1 - Binary output	Channel B - Output 4	Fan coil Valve	
+ Channel A 2 - Binary output	Channel C - Output 5	Binary output	•
+ Channel B 3 - Binary output	Channel C - Output 6 Channel D - Output 7	Binary output Binary output	•
+ Channel B 4 - Binary output	Channel D - Output 8	Binary output	•
+ Channel C 5 - Binary output			
+ Channel C 6 - Binary output	Channel E - Output 9	Binary output	•
+ Channel D 7 - Binary output			
+ Channel D 8 - Binary output			
+ Channel E 9 - Binary output	-		
Group Objects / Channels / Pa	arameter		





Depending on the type of output selected, more than one slot is occupied, for example, when selecting blinds outputs two outputs are reserved (odd output for the move up phase and even output for move down phase). Once selected blind output instead of having 2 channel output only appears 1 channel output combining the previous ones where all the blind parameters can be configured.

Once the types of inputs or outputs are selected, the communication objects associated to them will appear in the group objects menu.

Default communication objects and names are explained next.





#### 3.4 Outputs objects

#### 3.4.1 Binary outputs table

Object	Name   Function	Length	DPT	С	R	Flags W	Т	U
0	Channel A 1 - Binary output   Switch on/off	1 bit	1.001	•		•		
1	Channel A 1 - Binary output   Switch on/off status	1 bit	1.001	•	٠		•	
8	Channel A 2 - Binary output   Switch on/off	1 bit	1.001	•		•		
9	Channel A 2 - Binary output   Switch on/off status	1 bit	1.001	•	٠		•	
16	Channel B 3 - Binary output   Switch on/off	1 bit	1.001	•		•		
17	Channel B 3 - Binary output   Switch on/off status	1 bit	1.001	•	٠		•	
24	Channel B 4 - Binary output   Switch on/off	1 bit	1.001	•		•		
25	Channel B 4 - Binary output   Switch on/off status	1 bit	1.001	•	٠		•	
32	Channel C 5 - Binary output   Switch on/off	1 bit	1.001	•		•		
33	Channel C 5 - Binary output   Switch on/off status	1 bit	1.001	•	٠		•	
40	Channel C 6 - Binary output   Switch on/off	1 bit	1.001	•		•		
41	Channel C 6 - Binary output   Switch on/off status	1 bit	1.001	•	٠		•	
48	Channel D 7 - Binary output   Switch on/off	1 bit	1.001	•		•		
49	Channel D 7 - Binary output   Switch on/off status	1 bit	1.001	•	٠		•	
56	Channel D 8 - Binary output   Switch on/off	1 bit	1.001	•		•		
57	Channel D 8 - Binary output   Switch on/off status	1 bit	1.001	•	٠		•	
64	Channel E 9 - Binary output   Switch on/off	1 bit	1.001	•		٠		
65	Channel E 9 - Binary output   Switch on/off status	1 bit	1.001	•	٠		•	

#### 3.4.2 Binary outputs description

Name	Object X: Channel X Binary output   Switch on/off
Function	1-bit communication object for switching on and off an output.
Description	When a "1" is received through this object the output is switched. When a "0" is received through this object the output is switched off.
	This is the normally open behaviour that depends on the parameter "mode. The normally close behaviour is the opposite.
	By default, the status of an output is memorized when there is a power supply failure





Name	Object X: Channel X Binary output   Switch on/off status
Function	1-bit communication object for feedback signalling of state of the output.
Description	When the output is off and receives a switch on telegram a "1" is sent through this object. When the output is on and receives a switch off telegram "0" is sent through this object.

#### 3.4.3 Blind outputs table

Object	Name   Function	Length	DPT	C R	Flags W T I	U
0	Channel A 1/2 - Shutter/blind   Move up/down (0/1)	1 bit	1.001	•	•	
1	Channel A 1/2 - Shutter/blind   Stop	1 bit	1.001	•	•	
3	Channel A 1/2 - Shutter/blind   Position	1 byte	5.010	•	•	
4	Channel A 1/2 - Shutter/blind   Position status	1 byte	5.010	• •	•	
16	Channel B 3/4 - Shutter/blind   Move up/down (0/1)	1 bit	1.001	•	•	
17	Channel B 3/4 - Shutter/blind   Stop	1 bit	1.001	•	•	
19	Channel B 3/4 - Shutter/blind   Position	1 byte	5.010	•	•	
20	Channel B 3/4 - Shutter/blind   Position status	1 byte	5.010	• •	•	
32	Channel C 5/6 - Shutter/blind   Move up/down (0/1)	1 bit	1.001	•	•	
33	Channel C 5/6 - Shutter/blind   Stop	1 bit	1.001	•	•	
35	Channel C 5/6 - Shutter/blind   Position	1 byte	5.010	•	•	
36	Channel C 5/6 - Shutter/blind   Position status	1 byte	5.010	• •	•	
48	Channel D 7/8 - Shutter/blind   Move up/down (0/1)	1 bit	1.001	•	•	
49	Channel D 7/8 - Shutter/blind   Stop	1 bit	1.001	•	•	
51	Channel D 7/8 - Shutter/blind   Position	1 byte	5.010	•	•	
52	Channel D 7/8 - Shutter/blind   Position status	1 byte	5.010	• •	•	

#### 3.4.4 Blind outputs description

Name	Object X: Channel X - Shutter/blind   Move up/down (=0/1)
Function	1-bit communication object for moving up or down the blind.
Description	When a "1" is received through this object the blind moves down. When a "0" is received through this object the blind moves up.
	Odd outputs (Z1 and Z3) must be connected to the up phase of the motor. Even outputs (Z2 and Z4) must be connected to the down phase of the motor. This order cannot be altered.



Name	Object X: Channel X - Shutter/blind   Stop
Function	1-bit communication object for stop the blind movement.
Description	When any value is received through this object the blind motor stops moving.
Name	Object X: Channel X - Shutter/blind   Position
Function	1-byte communication object for direct positioning of the blind.
Description	When a value is sent to this object the blind moves to the received position
Name	Object X: Channel X - Shutter/blind   Position status
Function	1-byte communication object for feedback signalling of the position of the blind.
Description	When the blind motor stops the current position is sent through this object as feedback being 0 = completely closed and 255 = completely open.
	By default, the position of the blind is only sent when the motor stops. If the parameter "Status feedback during movement" is activated, the position of the blind is sent every second while it is moving

## 3.4.5 Fan-coil outputs table

Object	Name   Function	Length	DPT	Flags
0	Channel A/B - Fan Coil   Fan speed control	1 byte	5.010	C R W T U
1	Channel A/B - Fan Coil   Fan speed status	1 byte	5.010	• • •
3	Channel A/B - Fan Coil   Auto/manual (=0/1)	1 bit	1.001	• •
4	Channel A/B - Fan Coil   Auto/manual status (=0/1)	1 bit	1.001	• • •
5	Channel A/B - Fan Coil   Fan speed 1 (1=set/0=nothing)	1 bit	1.001	• •
6	Channel A/B - Fan Coil   Fan speed 2 (1=set/0=nothing)	1 bit	1.001	• •
7	Channel A/B - Fan Coil   Fan speed 3 (1=set/0=nothing)	1 bit	1.001	• •
8	Channel A/B - Fan Coil   Fan speed 1 status	1 bit	1.001	• • •
9	Channel A/B - Fan Coil   Fan speed 2 status	1 bit	1.001	• • •
10	Channel A/B - Fan Coil   Fan speed 3 status	1 bit	1.010	• • •
11	Channel A/B - Fan Coil   Fan on/off status	1 bit	1.001	• • •
12	Channel A/B - Fan Coil   Fan speed off (1=set/0=nothing)	1 bit	1.001	• •
32	Channel C/D - Fan Coil   Fan speed control	1 byte	5.010	• •



33	Channel C/D - Fan Coil   Fan speed status	1 byte	5.010	•	•		٠	
35	Channel C/D - Fan Coil   Auto/manual (=0/1)	1 bit	1.001	•		٠		
36	Channel C/D - Fan Coil   Auto/manual status (=0/1)	1 bit	1.001	٠	٠		٠	
37	Channel C/D - Fan Coil   Fan speed 1 (1=set/0=nothing)	1 bit	1.001	٠		٠		
38	Channel C/D - Fan Coil   Fan speed 2 (1=set/0=nothing)	1 bit	1.001	•		•		
39	Channel C/D - Fan Coil   Fan speed 3 (1=set/0=nothing)	1 bit	1.001	•		•		
40	Channel C/D - Fan Coil   Fan speed 1 status	1 bit	1.001	•	•		•	
41	Channel C/D - Fan Coil   Fan speed 2 status	1 bit	1.001	•	•		٠	
42	Channel C/D - Fan Coil   Fan speed 3 status	1 bit	1.010	٠	•		٠	
43	Channel C/D - Fan Coil   Fan on/off status	1 bit	1.001	•	•		•	
44	Channel C/D - Fan Coil   Fan speed off (1=set/0=nothing)	1 bit	1.001	•		•		





.....

#### 3.4.6 Fan coil outputs description

Name	Object X: Fan Coil   Fan speed X
Function	1-bit communication object for switch the fan coil to the corresponding speed.
Description	When a "1" is received through this object the fan-coil speed changes to the corresponding one. The other speeds are deactivated and a "0" is sent to the other speed objects for feedback.
	The speeds of the fan-coil must be connected to the outputs as following: Z1=speed 1, Z2=speed 2 and Z3=speed 3. If it is necessary to change this configuration use a "custom fan-coil"
Name	Object X: Fan Coil   Fan speed X status
Function	1-bit communication object for feedback signalling of the current speed.
Description	When a speed is selected the status is sent through this object. A telegram with value "1" is sent through the object of the speed selected and also "0" is sent through the other speeds objects.
Name	Object X: Fan Coil   Fan speed control
Function	1-byte communication object for direct speed selection.
Description	When a value is received through this object the fan coil control compares it to the threshold levels configured and activates the corresponding speed
Name	Object X: Fan Coil   Fan speed status
Function	1-byte communication object for feedback signalling of the current speed status.
Description	The current fan-coil speed value is sent through this object for feedback signalling with every change.
Name	Object X: Fan Coil   Auto/manual (=0/1)
Function	1-bit communication object to select fan-coil mode.
Description	When a "1" is received through this object, the fan coil changes to manual mode and when it receives a "0" it changes to automatic mode.
Name	Object X: Fan Coil   Auto/manual (=0/1) status
Function	1-bit communication object for feedback signalling of the fan coil mode.
Description	When a mode is selected, the status of the fan coil is sent through this object. A telegram of value "1" is sent in the case of manual mode and a "0" in case of automatic mode.
Name	Object X: Fan Coil   Fan on/off status
Function	1-bit communication object for feedback signalling of the fan coil status.
Description	When the fan coil is off and receives a switch on telegram, it sends "1" through this object. When the fan coil is on and receives a switch off telegram, it sends "0" through this object.
Name	Object X: Fan Coil   Fan speed off (1=set/0=nothing)
Function	1-bit communication object for fan coil switch off selection.





Description When a "1" is received through this object, the fan coil switches off and when it receives a "0" does not change its status.

.....

#### 3.4.7 Thermo-valve outputs table

				Flags
Object	Name   Function	Length	DPT	C R W T U
0	Channel A 1 - Valve   Open/close (=0/1)	1 bit	1.001	• •
1	Channel A 1 - Valve   Open/close status	1 bit	1.001	• • •
8	Channel A 2 - Valve   Open/close (=0/1)	1 bit	1.001	• •
9	Channel A 2 - Valve   Open/close status	1 bit	1.001	• • •
16	Channel B 3 - Valve   Open/close (=0/1)	1 bit	1.001	• •
17	Channel B 3 - Valve   Open/close status	1 bit	1.001	• • •
24	Channel B 4 - Valve   Open/close (=0/1)	1 bit	1.001	• •
25	Channel B 4 - Valve   Open/close status	1 bit	1.001	• • •
32	Channel C 5 - Valve   Open/close (=0/1)	1 bit	1.001	• •
33	Channel C 5 - Valve   Open/close status	1 bit	1.001	• • •
40	Channel C 6 - Valve   Open/close (=0/1)	1 bit	1.001	• •
41	Channel C 6 - Valve   Open/close status	1 bit	1.001	• • •
48	Channel D 7 - Valve   Open/close (=0/1)	1 bit	1.001	• •
49	Channel D 7 - Valve   Open/close status	1 bit	1.001	• • •
56	Channel D 8 - Valve   Open/close (=0/1)	1 bit	1.001	• •
57	Channel D 8 - Valve   Open/close status	1 bit	1.001	• • •
64	Channel E 9 - Valve   Open/close (=0/1)	1 bit	1.001	• •
65	Channel E 9 - Valve   Open/close status	1 bit	1.001	• • •



.....

#### 3.4.8 Thermo-valve outputs description

Name	Object X: Channel X - Valve   Open/close (=0/1)
Function	1-bit communication object for switching on and off a valve.
Description	When a "1" is received through this object the valve is switched. When a "0" is received through this object the valve is switched off.
	This is the normally open behaviour that depends on the parameter "mode. The normally close behaviour is the opposite.
	By default, the status of an output is memorized when there is a power supply failure
Name	Object X: Channel X - Valve   PWM control value (%duty)
Function	1-byte communication object for setting the duty cycle of the thermo-valve pwm output.
Description	The duty cycle of the pwm signal that controls the thermo-valve output is written by sending a value to this object.
Name	Object X: Channel X - Valve   Open/close status
Function	1-bit communication object for feedback signalling of state of the valve.
Description	When the valve is open and receives a switch on telegram a "1" is sent through this object. When the valve is close and receives a switch off telegram "0" is sent through this object.

#### 3.5 Outputs parameters

#### 3.5.1 Binary outputs parameters

When an output is configured as an individual binary output the following parameters can be configured:

General	Working mode	Normally open Normally close	
Outputs configuration	Normally open: On=close, Off=open	Normally close: On=open, Off=close	
Configuration	Status after voltage recovery	No change	•
Channel A 1 - Binary output	Lock/unlock	O Disable Enable	
Configuration	Scenes	O Disable C Enable	
Channel A 2 - Binary output	Timer	O Disable C Enable	
Configuration	Statistics	O Disable C Enable	
Channel B 3 - Binary output			
Channel B 4 - Binary output			
Channel C 5 - Binary output			
Channel C 6 - Binary output			
Channel D 7 - Binary output			

.....

.....



**Working mode:** Normally open or normally closed. In normally open mode the output relay is controlled with the standard logic: 1 = close, 0 = open. In normally closed mode the output relay is controlled with the inverse logic: 1 = open, 0 = close.

**Status after voltage recovery**: It can be controlled the status of the output after a voltage recovery. The available options are:

- "No change": The output will remain in the position that it had before the voltage loss.
- "Open output": The output will be open after a voltage recovery.
- "Closed output": The output will be closed after a voltage recovery.

Lock/unlock: It allows to have a new tab in the left side to configure the behaviour when the channel is locked (disabled) or unlocked (enabled).

General	Lock/unlock polarity	1=lock / 0=unlock 0=loc	ck / 1=unlock	
Outputs configuration	Behaviour when lock	51 L	•	
Configuration	Behaviour when lock	No change Last before lock		
Channel A 1 - Binary output				
Configuration				
Lock/unlock	1			
Scenes				
Timer				
Statistics				
Channel A 2 - Binary output				
Configuration				
Channel B 3 - Binary output				
Channel B 4 - Binary output				

Scenes: It allows to have a new tab in the left side to record and run up to 16 scenes.

1.1.1 Actuators v2 > Channel A 1	- Binary output > Scenes			
General	Number of scenes	1		•
- Outputs configuration	Scene number	1		\$
Configuration	Output value	O Off On		
- Channel A 1 - Binary output	Learn mode	No Ves		
Configuration	Delay	00:00:00	hh:mm:ss	
Lock/unlock				
Scenes	_			
Timer Statistics				
- Channel A 2 - Binary output				
Configuration				
+ Channel B 3 - Binary output				
+ Channel B 4 - Binary output				
Group Objects / Channels / P	arameter			





**Timer:** It allows to have a new tab in the left side to control the timing to activate or deactivate the output after switch on or switch off.

General	Switch on action	Delay on		•
- Outputs configuration	Delay time	00:00:05	hh:mm:ss	
Configuration	Switch off action	O Instant off	Delay off	
- Channel A 1 - Binary output	Delay time	00:00:05	hh:mm:ss	
Configuration				
Lock/unlock				
Scenes				
Timer				
Statistics				
- Channel A 2 - Binary output				
Configuration				
<ul> <li>Channel B 3 - Binary output</li> </ul>				
<ul> <li>Channel B 4 - Binary output</li> </ul>				

**Statistics:** It allows to have a new tab in the left side to count and inform about the time interval during which an output is closed and also to notify when it has been kept closed for a certain number of hours.

1.1.1 Actuators v2 > Channel A 1	1 - Binary output > Statistics		
General	Send running hours value (every 1 h)	O No Ves	
- Outputs configuration	Running hours alarm	No Ves	
Configuration	Alarm threshold	10000 ‡	Hours
- Channel A 1 - Binary output			
Configuration Lock/unlock Scenes Timer			
Statistics			
<ul> <li>Channel A 2 - Binary output</li> </ul>			
Configuration			
+ Channel B 3 - Binary output			
+ Channel B 4 - Binary output			
Group Objects Channels I	Parameter		





#### 3.5.2 Blind outputs parameters

When outputs are configured as blind outputs the following parameters can be configured:

General	Туре	Shutter (witho	out slats) 🧿 Blind (with sli	ats)
Outputs configuration	Travel time: up	00:00:30	hh:mm:ss	
Configuration	Travel time: down	00:00:30	hh:mm:ss	
Channel A 1/2 - Shutter/blind	Slats: total time	02.0	ss.f	
Configuration	Slats: number of steps	5		\$
Channel B 3/4 - Shutter/blind	Direction change pause	00.5	ss.f	
Channel C 5/6 - Shutter/blind	Additional time for adjustment	00.0	ss.f	
Channel D 7/8 - Shutter/blind	Status feedback during movement		nd) 💛 Yes (every second)	
	Use movement direction feedback object	O No O Yes		
	Status after voltage recovery	No change		•
	Lock/unlock	O Disable O I	Enable	
	Scenes	O Disable O B	Enable	

.....

Type: It allows to select the type of Shutter/Blind. With or without slats. If it is selected with slats will appear two more options:

- **Slats total time:** In this parameter it must be configured the measured time that the slats takes to open or close completely.
- **Slats number of steps:** In this parameter it must be configured the number of steps that the slats takes to open or close completely.

Travel time up: In this parameter it must be configured the measured time that the blind takes to raise up completely.

Travel time down: In this parameter it must be configured the measured time that the blind takes to raise down completely.

**Direction change pause:** This parameter is a value (in ss.f) for a dead time that the device waits before changing the direction of the blind while it is moving.

Additional time for adjustment: Defines an additional time in ss.f for complete blind position adjustment when it gets the upper or lower limit. The corresponding output remains closed an extra time measured in ss.f.

**Status feedback during movement:** This parameter allows to receive a feedback signalling of the current position of the blind just at the end of the movement or at every second.

**Use movement direction feedback object:** This parameter allows to receive a feedback signalling of the current moving direction of the blind or not.

Status after voltage recovery: It can be controlled the position of the blind after a voltage recovery with a percentage between 0 and 100.

**Lock/unlock:** It allows to have a new tab in the left side to configure the behaviour when the channel is locked (disabled) or unlocked (enabled).





General	Lock/unlock polarity	1=lock / 0=unlock 0=lock	:/1=unlock	
Outputs configuration	Behaviour when lock	No change	*	
Configuration	Behaviour when unlock	Last before lock	•	
Channel A 1/2 - Shutter/blind				
Configuration				
Lock/unlock				
Scenes				
Alarm				
Channel B 3/4 - Shutter/blind				
Channel C 5/6 - Shutter/blind				
Channel D 7/8 - Shutter/blind				

Scenes: It allows to have a new tab in the left side to record and run up to 16 scenes.

General	Number of scenes	1	
Outputs configuration	Scene number	1	
Configuration	Action	O Move to position	Move position and slats
Channel A 1/2 - Shutter/blind	Position	0 %	
Configuration	Learn mode	🔿 No 🧿 Yes	
Lock/unlock	Delay	00:00:00	hh:mm:ss
Scenes			
Alarm			
Channel B 3/4 - Shutter/blind			
Channel C 5/6 - Shutter/blind			
Channel D 7/8 - Shutter/blind			
Channel D 7/8 - Shutter/blind			

**Alarm:** It allows to have a new tab in the left side to configure the alarm behaviour. If it receives "0", it starts counting the monitoring period, or executes the action set in the "behaviour when alarm = 0" parameter. Each time it receives a "0", the time is preloaded again. If no other "0" is received and the monitoring time has elapsed, an alarm or programmed alarm action is executed. If it receives "1", it begins to execute the configured alarm actions.

General	Alarm monitoring	🔿 No 🄘 Yes	
Outputs configuration	Monitoring period	00:10:00 hh:m	miss
Configuration	Behaviour when alarm = 1	Move down	•
Channel A 1/2 - Shutter/blind	Behaviour when alarm = 0	Last position before alarm	-
Configuration Lock/unlock Scenes			
Alarm	1		
Channel B 3/4 - Shutter/blind			
Channel C 5/6 - Shutter/blind			
Channel D 7/8 - Shutter/blind			



.....

#### 3.5.3 Fan-coil outputs parameters

When outputs are configured as fan-coil outputs the following parameters can be configured:

General	Fan coil control type	<ul> <li>Direct (change-over)</li> <li>Sequential (hierarchically)</li> </ul>	
Outputs configuration			
Configuration	Fan speed 1 threshold	10 %	•
Channel A/B - Fan coil	Fan speed 2 threshold	40 %	•
	Fan speed 3 threshold	70 %	*
Configuration	Hysteresis	5 %	•
Channel C/D - Fan coil			
	Manual function	O No 🔿 Yes	
	Status after voltage recovery	No change	•
	Delays	O Disable C Enable	
	Lock/unlock	O Disable C Enable	
	Scenes	O Disable O Enable	

The received value through the fan-coil control communication object <<Fan X mode [1 byte]>> it is compared to these threshold levels by the device (see section **¡Error! No se encuentra el origen de la referencia. ¡Error! No se encuentra origen de la referencia.** on page **¡Error! Marcador no definido.**).

Fan coil control type: It can be selected between direct or sequential type. In the direct type only the relay corresponding to the selected speed is activated, while in the sequential type the relay of the selected speed and the previous ones are activated.

**Fan speed threshold level 1:** (from 0 to 255) if the fan-coil control value is lower than this threshold level the outputs of the fan-coil are switched off. If the control value is higher the Output O1 is switched on.

**Fan speed threshold level 2:** (from 0 to 255) if the fan-coil control value is lower than this threshold level the Output O1 is switched on. If the control value is higher the Output O1 is switched off and the Output 2 is switched on.

**Fan speed threshold level 3:** (from 0 to 255) if the fan-coil control value is lower than this threshold level the Output O2 is switched on. If the control value is higher the Output O2 is switched off and the Output 3 is switched on.

Hysteresis: percentage to indicate the activation or deactivation threshold of the outputs.

Manual function: manual mode.

Status after voltaje recovery: It allows to select a certain percentage between 0 and 100 for the fan coil after a voltage recovery.

Delays: delays can be set to the activation and/or to deactivation of the fan coil.

**Lock/unlock:** It allows to have a new tab in the left side to configure the behaviour when the channel is locked (disabled) or unlocked (enabled).

Scenes: It allows to have a new tab in the left side to record and run up to 16 scenes.





#### 3.5.4 Thermo-valve outputs parameters

When outputs are configured as thermo valves outputs the following parameters can be configured:

General	Working mode	Normally open Normally close	
Outputs configuration	Normally open: 1=close, 0=open   1	Normally close: 1=open, 0=close	
Configuration	Type of control	On/off PWM	
Channel A 1 - Valve	Status after voltage recovery	No change	
Configuration			
Channel A 2 - Valve	Lock/unlock	Disable  Enable	
Channel B 3 - Valve	Valve protection	O Disable C Enable	
Channel B 4 - Valve			
Channel C 5 - Valve			
Channel D 6 - Valve			
Channel D 7 - Valve			
Channel D 8 - Valve			
Channel E 9 - Valve			

**Working mode:** Normally open or normally closed. In normally open mode the output relay is controlled with the standard logic: 1 = close, 0 = open. In normally closed mode the output relay is controlled with the inverse logic: 1 = open, 0 = close.

Type of control: It can be selected the type of control for the valve. The available options are:

- "On/off": It is controlled the opening and closing of the valve.
- "PWM:": It is established a period of time in which the valve is open a certain percentage of this time introduced through the correspondent communication object and closed the remaining percentage of time until reach 100% of the total time established.

Type of control	On/off O PWM	
Period of time	00:01:00	hh:mm:ss

**Status after voltage recovery:** It can be controlled the status of the output after a voltage recovery. The available options are:

- "No change": The output will remain in the position that it had before the voltage loss.
- "Open output": The output will be open after a voltage recovery.
- "Closed output": The output will be closed after a voltage recovery.

Lock/unlock: It allows to have a new tab in the left side to configure the behaviour when the channel is locked (disabled) or unlocked (enabled).



1.1.1 Actuators v2 > Channel	A 1 - Valve > Lock/unlock			
General	Lock/unlock polarity	1=lock / 0=unlock 0=loc	k / 1=unlock	
- Outputs configuration	Valve status when lock	No change		
Configuration	Valve status when unlock	Last before lock	•	
- Channel A 1 - Valve				
Configuration				
Lock/unlock				
+ Channel A 2 - Valve				
+ Channel B 3 - Valve				
+ Channel B 4 - Valve				
+ Channel C 5 - Valve				
+ Channel D 6 - Valve				
+ Channel D 7 - Valve				
+ Channel D 8 - Valve				
Group Objects Channels	Parameter			

Valve protection: When this function is activated, the device automatically closes the output for 5 seconds, according to the time established for the protection cycle.

Valve protection	O Disable	O Enable	
Protection cycle after	360	+	Hours

.....

#### 3.6 Advanced functions

If the advanced functions are enabled in the General menu, a new submenu appears on the left.

comgaration	Arithmetic-logic unit		
Channel A 1 - Valve	Block 1	Disable O Enable	
Configuration	Block 2	O Disable C Enable	
Lock/unlock	Block 3	O Disable C Enable	
Channel A 2 - Valve	Block 4	Disable Enable	
Channel B 3 - Valve	Block 5	O Disable C Enable	
	Block 6	O Disable C Enable	
Channel B <mark>4</mark> - Valve	Block 7	O Disable C Enable	
Channel C 5 - Valve	Block 8	O Disable O Enable	
Channel D 6 - Valve	Timers/counters	2	
Channel D 7 - Valve	Block 1	🔵 Disable 🔘 Enable	
Channel D 8 - Valve	Block 2	Disable Enable	
Channel E 9 - Valve	Block 3	O Disable C Enable	
Advanced functions	Block 4	O Disable Enable	
	Block 5	O Disable O Enable	
Configuration	Block 6	O Disable Enable	

In this configuration menu it is possible to select what Arithmetic and logic or timers / counters blocks are enabled.



.....

Name	Arithmetic-logic block X
Values	Enable / Disable
Description	Allows to enable or disable each arithmetic and logic block.
Name	Timer / counter block
Values	Enable / Disable
Description	Allows to enable or disable the each timer / counter blocks.

#### 3.6.1 Arithmetic and Logic block (ALU)

Configuration	Operation	AND	+
Lock/unlock			
Channel A 2 - Valve	Number of inputs	2	-
	Input 1	Communication object	ct 🔘 Constant value
<ul> <li>Channel B 3 - Valve</li> </ul>	Format	1 bit	*
- Channel B 4 - Valve	Input 2	1 bit	<b>*</b>
- Channel C 5 - Valve			
Channel D 6 - Valve	Output	1 bit	*
- Channel D 7 - Valve			
- Channel D 8 - Valve			
- Channel E 9 - Valve			
<ul> <li>Advanced functions</li> </ul>			
Configuration			
Block 1 - ALU			
Block 1 - Timer/counter			

Name	Operation
Values	AND, NAND, OR, NOR, XOR, XNOR, NOT, BUFFER, == , != , <, > , <= , >= , + , - , *, / .
Description	It allows to select the arithmetic or logic operation of the block: Logic operations: - AND: Logic product - NAND: Negative logic product - OR: Logic addition - NOR: Negative logic addition - XOR: Negative logic addition - XNOR: Negative exclusive logic addition - NOT: Negation - BUFFER: Saves the input value in the output. Comparison operation: - == : equality - != : inequality - <: smaller than - > : greater than - >= : greater or equal than



	Arithmetic operations: - +: addition : subtraction
	- *: multiplication
	/ : division
Name	Number of inputs
Values	From 2 to 4
Description	This parameter defines the number of inputs of the block. Depending on the type of operation it is allowed two or more inputs.
Name	Input 1
Values	Communication object / Constant value
Description	This parameter allows to select the type of the input 1, that can be a constant value or a value received from a communication object.
Name	Format
Values	1 bit, 1 byte unsigned (dpt 5.001), 1 byte unsigned (dpt 5.010), 1 byte signed (6.*), 2 bytes unsigned (dpt 7,*), 2 bytes unsigned (dpt 8,*), 2 bytes float (dpt 9,*).
Description	This parameter allows to select the size and format of the input 1. Depending on the type of operation different formats are allowed.
Name	Input 2/3/4
Values	1 bit, 1 byte unsigned (dpt 5.001), 1 byte unsigned (dpt 5.010), 1 byte signed (6.*), 2 bytes unsigned (dpt 7,*), 2 bytes unsigned (dpt 8,*), 2 bytes float (dpt 9,*).
Description	This parameter allows to select the size and format of the other inputs communication objects. Depending on the type of operation different formats are allowed.

#### 3.6.2 Timer / counter block

Configuration	Type of block	Counter	
Lock/unlock	Timer type	PWM	*
+ Channel A 2 - Valve	Period of time	Communication object Constant value	
+ Channel B 3 - Valve	Format	1 byte (dpt 5.010)	
+ Channel B 4 - Valve	romat	r byte (apt 5.010)	
+ Channel C 5 - Valve	Duty	1 byte (dpt 5.010)	-
+ Channel D 6 - Valve			
+ Channel D 7 - Valve			
+ Channel D 8 - Valve			
+ Channel E 9 - Valve			
<ul> <li>Advanced functions</li> </ul>			
Configuration			
Block 1 - ALU			
Block 1 - Timer/counter			




.....




#### Name Timer type


Values PWM, Limit, Cyclic

Description PWM: It generates a pulse width modulated output according to the period of time and a duty.

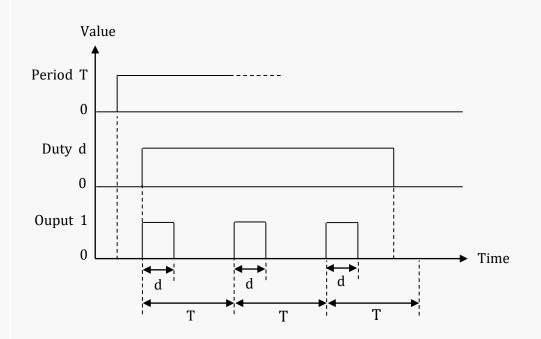

Limit: It sends a bit telegram '1' to the bus when a limit value is exceeded.

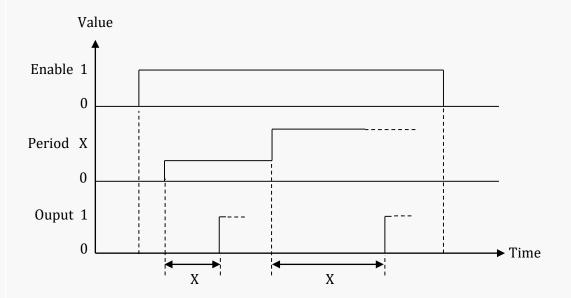

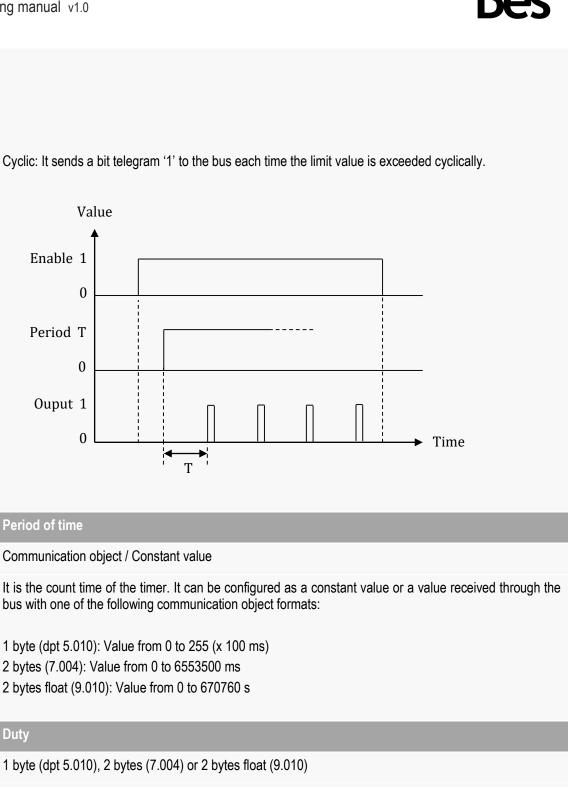

Cyclic: It sends a bit telegram '1' to the bus each time the limit value is exceeded cyclically.

Description Only visible if timer type PWM is selected. It is the time that the output signal is at high level ("1") within the period of time. Its value can be received through the bus with one of the following communication object formats:

> 1 byte (dpt 5.010): Value from 0 to 255 (x 100 ms) 2 bytes (7.004): Value from 0 to 6553500 ms 2 bytes float (9.010): Value from 0 to 670760 s

Name

Values

Name

Values

Description




1.1.1 Actuators v2 > Advanced functions > Block 1 - Timer/counter				
Configuration	Type of block	O Timer O Counter		
Lock/unlock	Counter type (increase with)	Rising edge	•	
+ Channel A 2 - Valve				
+ Channel B 3 - Valve	Limit value	10	¢	
+ Channel B 4 - Valve	Output behavior	Send 1 if limit reached	•	
+ Channel C 5 - Valve	-			
+ Channel D 6 - Valve	_			
+ Channel D 7 - Valve				
+ Channel D 8 - Valve				
+ Channel E 9 - Valve	-			
- Advanced functions	-			
Configuration				
Block 1 - ALU				
Block 1 - Timer/counter				
Group Objects / Channels / Parameter				

Name	Counter type	
Values	Rising edge, falling edge, 1 or 0	
Description	It is the change that the counter may detect in its "event" object to increase the count.	
Name	Limit value	
Values	From 0 to 65535	
Description	It is the number of events over which the counter sends the finish telegram.	
Name	Output behaviour	
Values	Send 1 when limit reached, Send counter value (5.010), Send counter value (7.001)	
Description	This parameter allows to select the format and behaviour of the counter output. It can be send a 1 when the count limit is reached or it can send the count value each time an event is detected.	





## 4 Installation

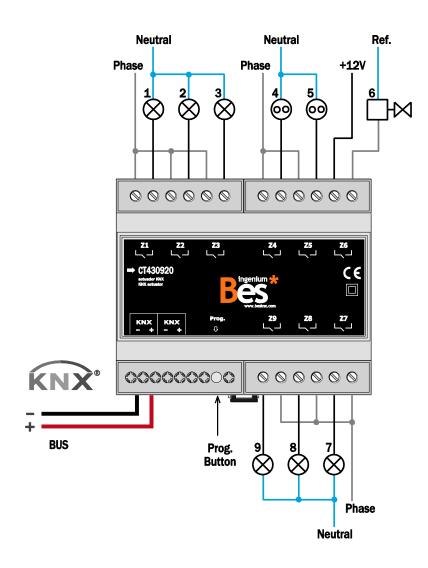


# $\wedge$

Feed low voltage lines (BUS and inputs) in separate ducting to that of power (230V) and outputs to ensure there is enough insulation and avoid interferences.

Do not connect the main voltages (230V) or any other external voltages to any point of the BUS or inputs.



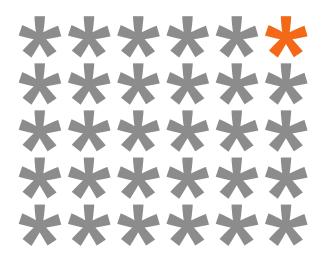

# KNX products by ingenium



Výhradní distributor pro ČR a SR:

**Stakohome Innovation s.r.o.** Aloisovská 934/8, 198 00 Praha 9 Hloubětín Česká republika



Tel.: +420 226 517 522 Mob.: +420 777 780 384 info@besknx.cz www.besknx.cz

<u>Liability limitation</u>: The present document is subject to changes or excepted errors. The contents are continuously checked to be according to the hardware and software but deviations cannot be completely excluded. Consequently any liability for this is not accepted. Please inform us of any suggestion. Every correction will be incorporated in new versions of this manual.

Manual version: v1.0